

# Yucel-Series - Valve Regulated Lead Acid Battery Y3.2-12

## **Data Sheet**



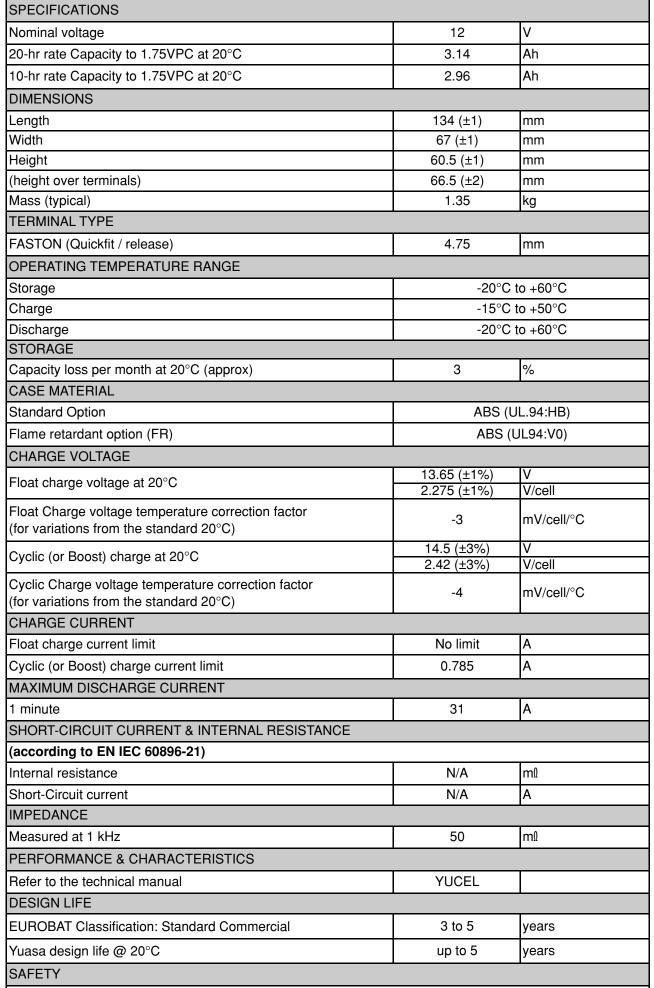

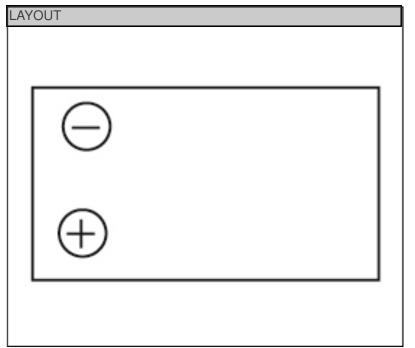

#### **3RD PARTY CERTIFICATIONS**

ISO 9001 - Quality Management Systems
ISO 14001 - Environmental Management Systems
EN 18001 - OHSAS Management Systems
UNDERWRITERS LABORATORIES Inc.



#### **STANDARDS**

IEC61056







ALL DATA IS SUBJECT TO CHANGE WITHOUT NOTICE Issue No.: V.1 / Issue Date: July 2010



YUASA BATTERY SALES UK LTD. Unit 22 Rassau Industrial Estate Ebbw Vale, Gwent NP23 5SD UK

#### Installation

Can be installed and operated in any orientation except permanently inverted

#### nanules

Batteries must not be suspended by their handles (where fitted)

#### Vent valves

Each cell is fitted with a low pressure release valve to allow gasses to escape and then reseal.

### Gas Release

VRLA Batteries release hydrogen gas which can form explosive mixtures in air. Do not place inside a sealed container

#### Recycling

YUASA's VRLA batteries must be recycled at the end of life in accordance with local and national laws and regulations